
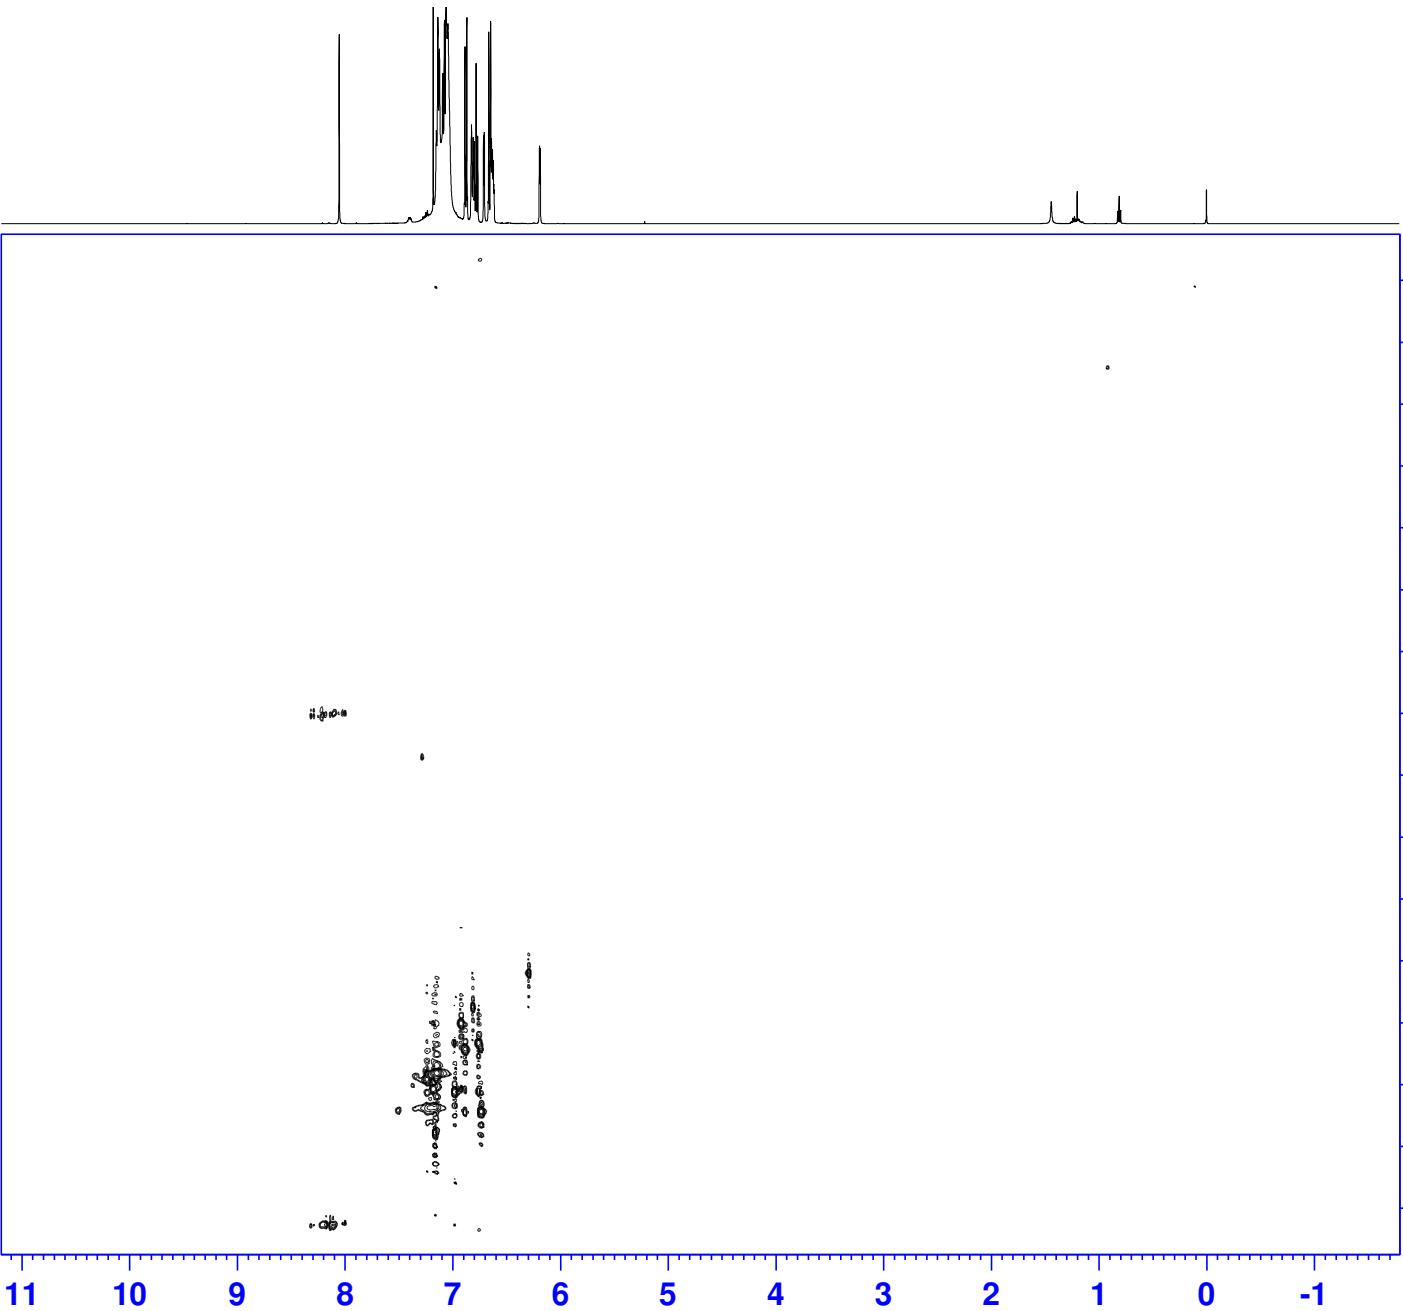


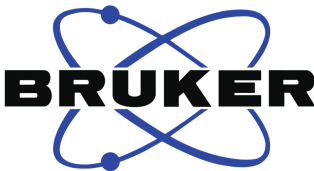

Current Data Parameters
NAME Nov14-2023-braese
EXPNO 152
PROCNO 1

F2 - Acquisition Parameters
Date_ 20231115
Time 1.09 h
INSTRUM spect
PROBHD Z125869_0021 (PULPROG hsqcedetgpsisp2.3
TD 2048
SOLVENT CDC13
NS 8
DS 32
SWH 6493.506 Hz
FIDRES 6.341315 Hz
AQ 0.1576960 sec
RG 197.51
DW 77.000 usec
DE 24.97 usec
TE 298.0 K
CNST2 145.0000000
CNST17 -0.5000000
D0 0.00000300 sec
D1 1.50000000 sec
D4 0.00172414 sec
D11 0.03000000 sec
D16 0.00020000 sec
D21 0.00344800 sec
D24 0.00086200 sec
INO 0.00002410 sec
TDAV 1
ZGPGTNS
SFO1 500.1323506 MHz
NUC1 1H
P1 12.00 usec
P2 24.00 usec
PLW1 14.00000000 W
SFO2 125.7672204 MHz
NUC2 13C
CPDPRG2 garp4
P3 10.00 usec
P14 500.00 usec
P24 2000.00 usec
P31 1895.00 usec
PCPD2 70.00 usec
PLW0 0 W
PLW2 65.00000000 W
PLW12 1.32650006 W
SPNAM[3] Crp60,0.5,20.1
SFOAL3 0.500
SPOFFS3 0 Hz
SPW3 9.93130016 W
SPNAM[7] Crp60comp.4
SFOAL7 0.500
SPOFFS7 0 Hz
SPW7 9.93130016 W
SPNAM[18] Crp60_xfilt.2
SFOAL18 0.500
SPOFFS18 0 Hz
SPW18 2.39219999 W
GPNAM[1] SMSQ10.100
GPZ1 80.00 %
GPNAM[2] SMSQ10.100
GPZ2 20.10 %
GPNAM[3] SMSQ10.100
GPZ3 11.00 %
GPNAM[4] SMSQ10.100
GPZ4 -5.00 %
P16 1000.00 usec
P19 600.00 usec

F1 - Acquisition parameters
TD 256
SFO1 125.7672 MHz
FIDRES 162.085068 Hz
SW 164.963 ppm
FAMODE Echo-Antiecho

F2 - Processing parameters
SI 1024
SF 500.1300000 MHz
WDW QSINE
SSB 2
LB 0 Hz
GB 0
PC 1.40

F1 - Processing parameters
SI 1024
MC2 echo-anticho
SF 125.7577885 MHz
WDW QSINE
SSB 2
LB 0 Hz
GB 0